



### EQ / ER 400-4A

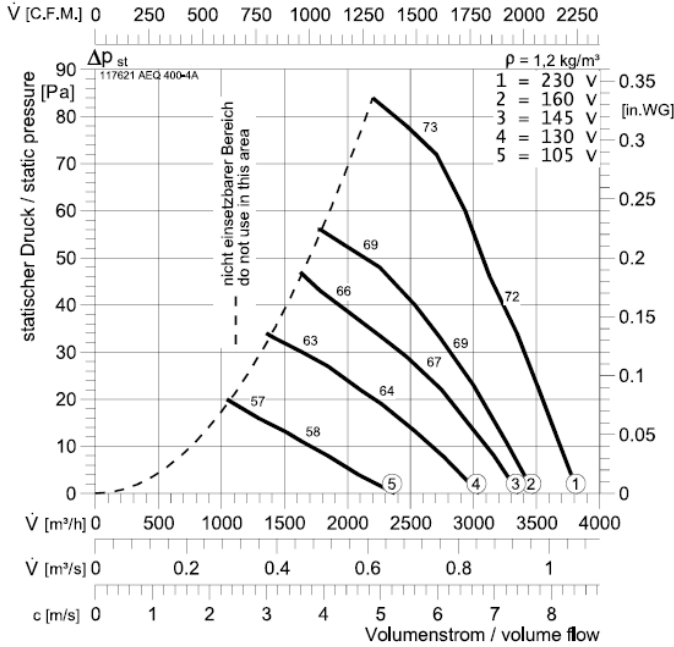

<b>Typ :</b> EQ / ER 400-4A	$I_A/I_N$ :	3,2	$\Delta$ dB	$L_{WA5}$	$L_{WA6}$
<b>Art.Nr.:</b> 1017900043 / 0617900043		IP 44	$L_{WA \text{ tot}}$	0	0
<b>■ :</b> 9,4/8,8	<b>kg</b>		E13	125 Hz	-36 -36
<b>U :</b> 230 V 50 Hz			GS 2	250 Hz	-24 -24
<b>P<sub>1</sub> :</b> 0,17	<b>kW</b>		NE 1,5	500 Hz	-9 -9
<b>I<sub>N</sub> :</b> 0,75	<b>A</b>		RPE 02 A	1 kHz	-6 -6
<b>n :</b> 1395	<b>min<sup>-1</sup></b>			2 kHz	-4 -4
<b>C<sub>400V</sub> :</b> 6	<b>μF</b>			4 kHz	-8 -8
<b>t<sub>R</sub> :</b> 50	<b>°C</b>			8 kHz	-19 -19

### DQ / DR 400-4A

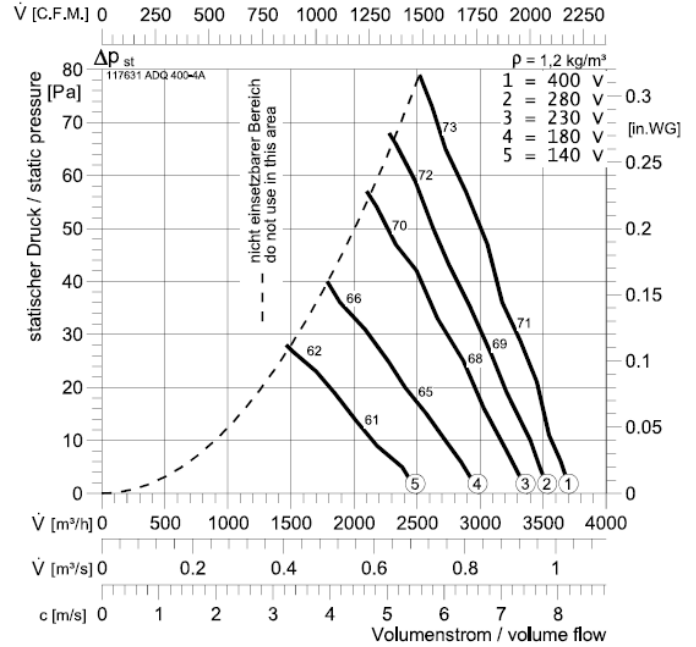

<b>Typ :</b> DQ / DR 400-4A	$I_A/I_N$ :	3	$\Delta$ dB	$L_{WA5}$	$L_{WA6}$
<b>Art.Nr.:</b> 1017900044 / 0617900044		IP 44	$L_{WA \text{ tot}}$	0	0
<b>■ :</b> 9/9	<b>kg</b>		DD0b	125 Hz	-36 -36
<b>U :</b> 400 V 50 Hz			GS 2	250 Hz	-24 -24
<b>P<sub>1</sub> :</b> 0,165	<b>kW</b>		RTD 1,2	500 Hz	-9 -9
<b>I<sub>N</sub> :</b> 0,43	<b>A</b>		SAD 9	1 kHz	-6 -6
<b>n :</b> 1390	<b>min<sup>-1</sup></b>			2 kHz	-4 -4
<b>C<sub>400V</sub> :</b> -	<b>μF</b>			4 kHz	-8 -8
<b>t<sub>R</sub> :</b> 50	<b>°C</b>			8 kHz	-19 -19

